


GARY SHAW
ARCHITECTS

design
+
planning

1821 margaret st.
austin, texas 78704
off; (512)416-8471
fax; (512)416-8478

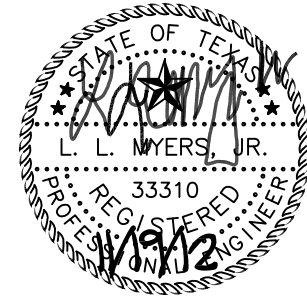

KENEDY RETAIL

131 BUSINESS
PARK DRIVE
KENEDY, TEXAS
78119

project no.

167.1201

date

11/19/12

scale:


1/8" = 1'-0"

revisions

FLOOR PLAN-
ELECTRICAL

sheet no.

E2.0

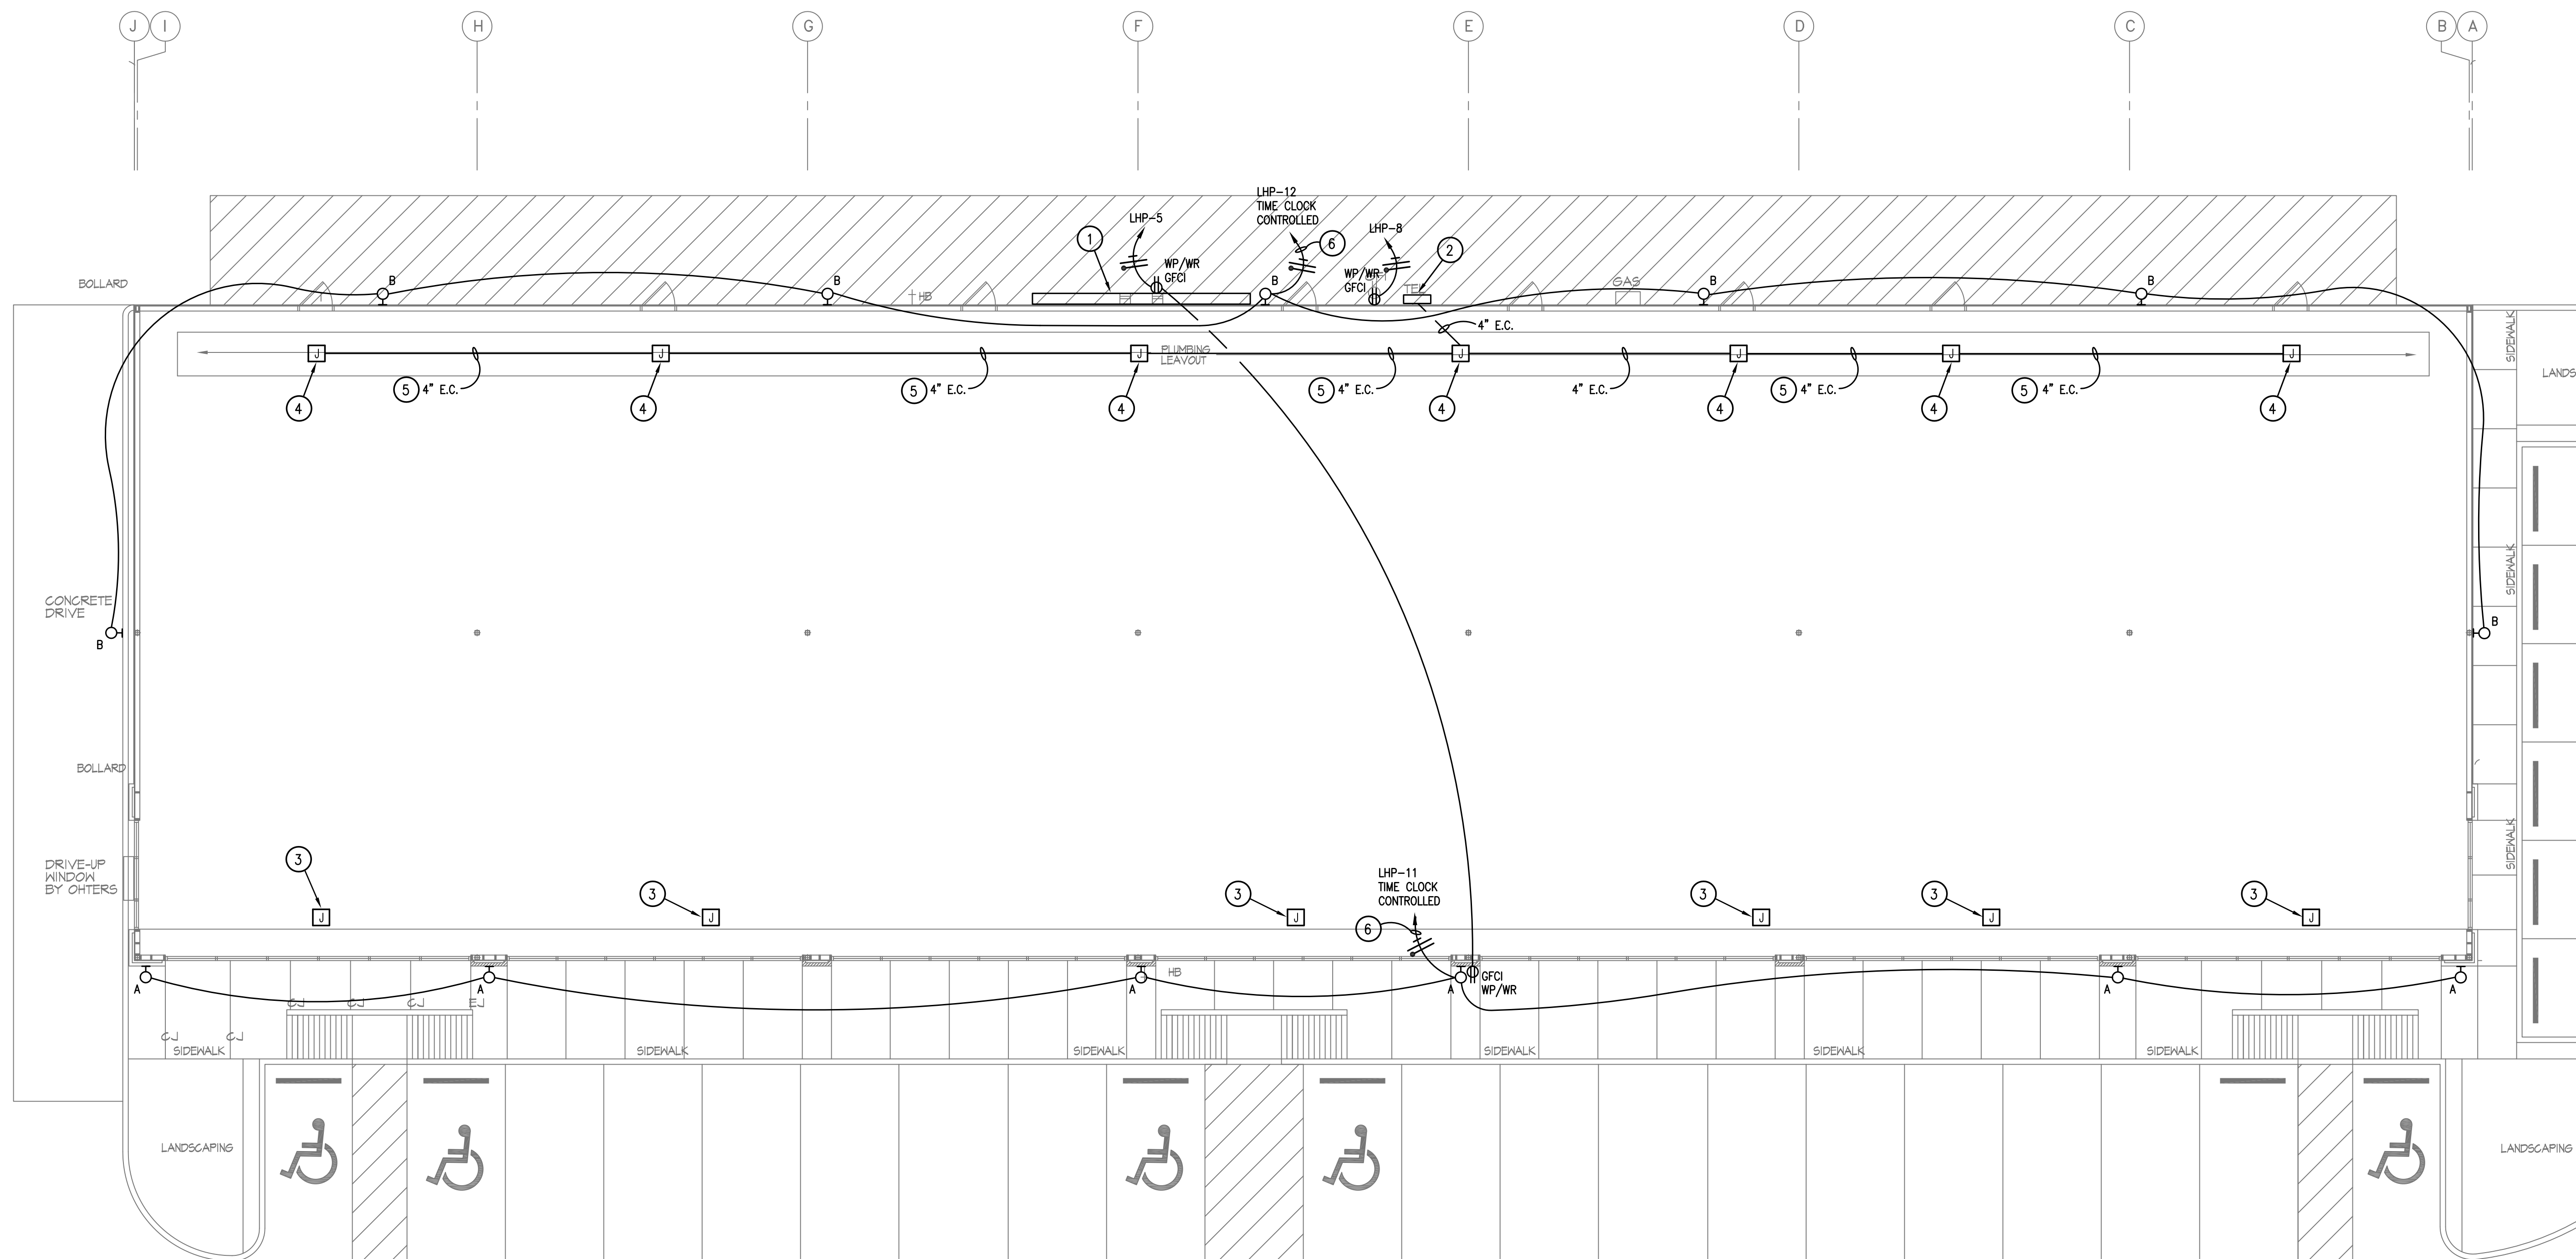

1 FLOOR PLAN - ELECTRICAL

SCALE: 1/8" = 1'-0"

GENERAL NOTES


1. ALL WIRING SHALL BE 2 #12 & 1 #12 GND. UNLESS OTHERWISE NOTED ON DRAWINGS.

EXTERIOR LIGHTING CONTROLS NOTE:

1. CONTRACTOR SHALL PROVIDE AN ASTRONOMICAL TIME CLOCK TO CONTROL ALL EXTERIOR LIGHTING CIRCUITS. PROVIDE TIME CLOCK MANUFACTURED BY TORK OR APPROVED EQUAL.

KEYED NOTES

- 1 ELECTRIC SERVICE ENTRANCE LOCATION. REFER TO ELECTRICAL RISER DIAGRAM 2/E3.0 & SITE PLAN 1/EU1.0.
- 2 TELEPHONE SERVICE ENTRANCE LOCATION. COORDINATE CONNECTION AND REQUIREMENTS WITH LOCAL TELEPHONE COMPANY. REFER TO SITE PLAN 1/EU1.0.
- 3 J-BOX IN JOISTS FOR TENANT SIGNAGE RELAY. ROUTE 1" CONDUIT BACK TO PANEL "LHP".
- 4 10"x10"x6" NEMA 1 PULLBOX FOR TELEPHONE. MOUNTED TO ROOF STRUCTURE.
- 5 PROVIDE PULL STRING FROM FUTURE TENANT SPACE BACK TO TELECOMMUNICATION SERVICE ENTRANCE.
- 6 2 #10 & 1 #10 GND. IN 3/4"C.

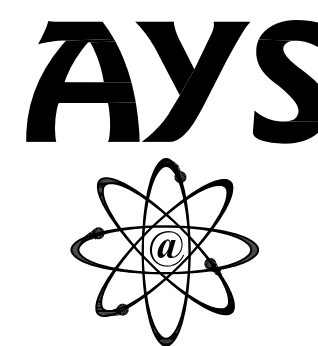

Engineering, LLC
MEP CONSULTING ENGINEERING
203 E. Main Street, Suite 204 • Round Rock • TX 78664
www.AYSEng.com • 512-961-6835
TDPE Firm F-10298